




### Conducted Emission Measurement

File :PI-SB01  
80.0 dBuV

Data :#1

Date: 2006/3/6

Time: 下午 03:41:47

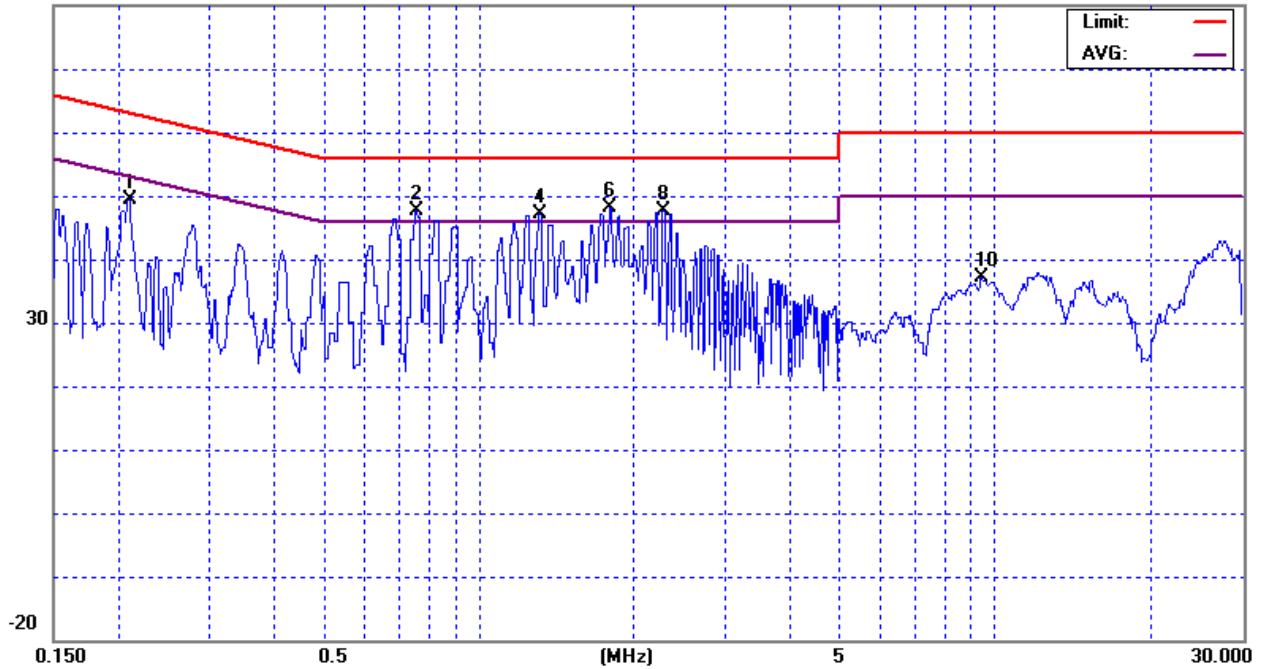

Site C01-BTL

Limit: CISPR22 Class B Conduction(QP)

EUT: MONITOR

M/N: PI-SB01

Mode:

Note:

Phase: **L1**

Power: AC 230V/50Hz

Distance:

Temperature: 24 °C

Humidity: 57 %

Air Pressure: 1002. hpa

No.	Mk.	Freq. MHz	Reading Level dBuV	Factor dB	Measure- ment dBuV	Limit dBuV	Over dB	Detector	Comment
1		0.2095	39.39	10.00	49.39	63.23	-13.84	peak	
2		0.7587	37.64	10.00	47.64	56.00	-8.36	peak	
3		0.7587	35.24	10.00	45.24	46.00	-0.76	AVG	
4		1.3100	37.20	9.99	47.19	56.00	-8.81	peak	
5	*	1.3100	35.85	9.99	45.84	46.00	-0.16	AVG	
6		1.7937	38.20	9.98	48.18	56.00	-7.82	peak	
7		1.7937	35.63	9.98	45.61	46.00	-0.39	AVG	
8		2.2775	37.56	9.95	47.51	56.00	-8.49	peak	
9		2.2775	34.25	9.95	44.20	46.00	-1.80	AVG	
10		9.4375	27.10	9.93	37.03	60.00	-22.97	peak	

\*:Maximum data x:Over limit !:over margin

●Reference Only




### Conducted Emission Measurement

File :PI-SB01  
80.0 dBuV

Data :#2

Date: 2006/3/6

Time: 下午 03:45:08

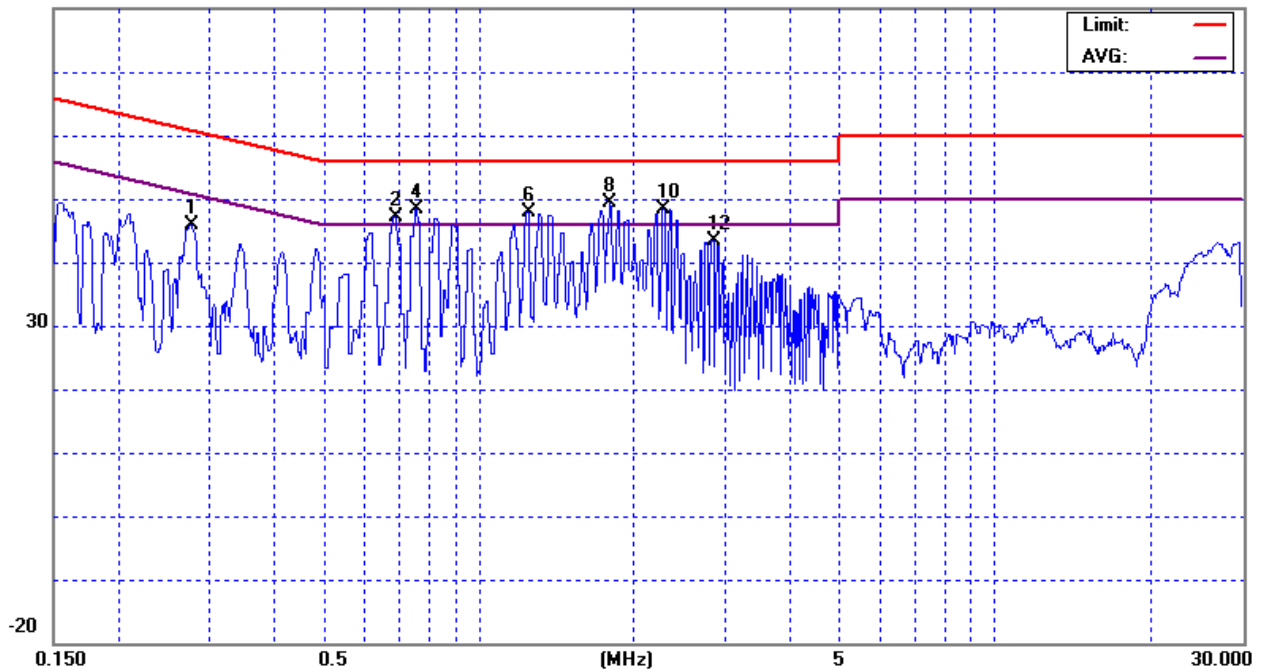

Site C01-BTL

Phase: **N**

Temperature: 24 °C

Limit: CISPR22 Class B Conduction(QP)

Power: AC 230V/50Hz

Humidity: 57 %

EUT: MONITOR

Distance:

Air Pressure: 1002. hpa

M/N: PI-SB01

Mode:

Note:

No.	Mk.	Freq. MHz	Reading Level dBuV	Factor dB	Measure- ment dBuV	Limit dBuV	Over dB	Detector	Comment
1		0.2769	35.86	10.00	45.86	60.91	-15.05	peak	
2		0.6912	37.09	10.00	47.09	56.00	-8.91	peak	
3		0.6912	35.76	10.00	45.76	46.00	-0.24	AVG	
4		0.7587	38.34	10.00	48.34	56.00	-7.66	peak	
5	X	0.7587	36.23	10.00	46.23	46.00	0.23	AVG	
6		1.2425	38.00	10.00	48.00	56.00	-8.00	peak	
7	X	1.2425	36.31	10.00	46.31	46.00	0.31	AVG	
8		1.7937	39.41	9.98	49.39	56.00	-6.61	peak	
9	*	1.7937	36.48	9.98	46.46	46.00	0.46	AVG	
10		2.2775	38.54	9.95	48.49	56.00	-7.51	peak	
11		2.2775	35.49	9.95	45.44	46.00	-0.56	AVG	
12		2.8400	33.47	9.93	43.40	56.00	-12.60	peak	

\*:Maximum data x:Over limit !:over margin

●Reference Only